

CONDUCTOR #5

CONDUCTOR #6

113920 1.5% Cu, 0.3% Ni
113919 1.2% Cu, 0.2% Ni
113907 0.9% Cu, 0.2% Ni




1.4% Cu, 0.2% Ni 113921
1.6% Cu, 0.3% Ni 113914

113922 0.3% Cu, 0.5% Ni
113915 0.6% Cu, 0.4% Ni

1.6% Cu, 0.2% Ni 113929

113916 0.7% Cu, 0.4% Ni
113923 0.7% Cu, 0.6% Ni

Legende

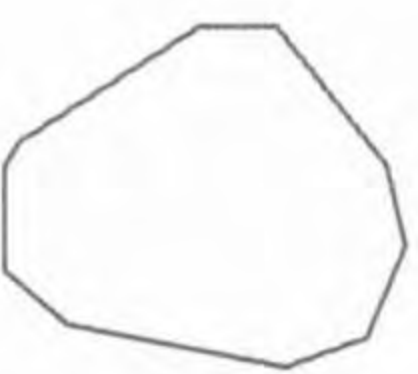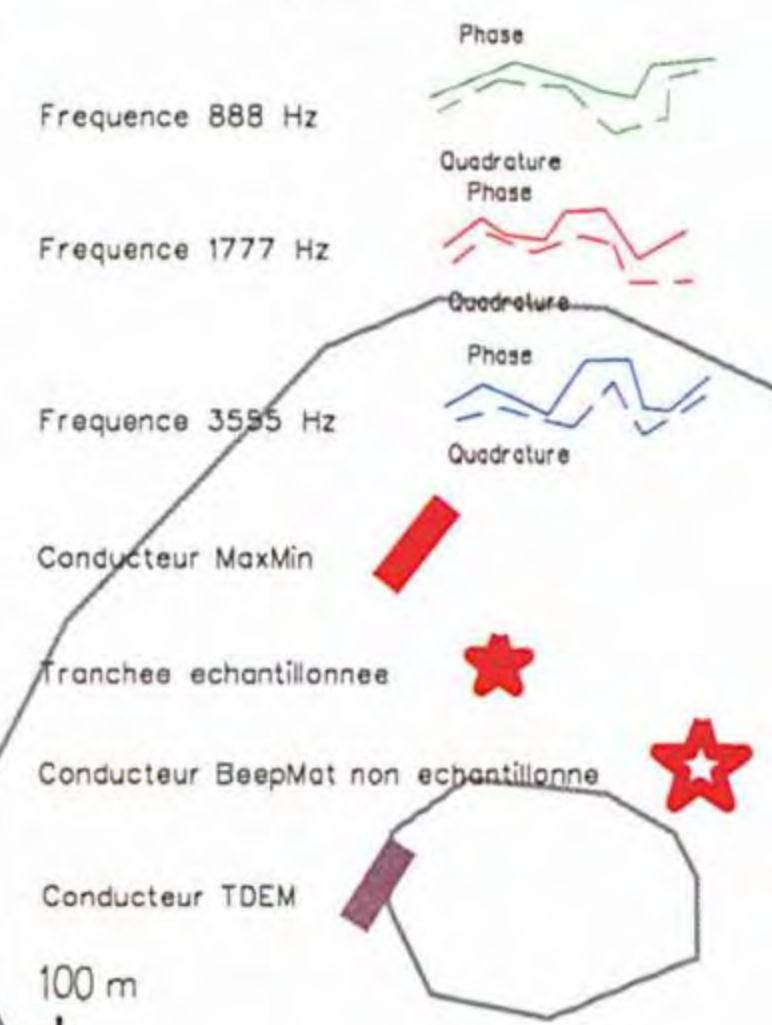

GM 64173

761520

Figure 6 : after GM-64173
Quebec Government Assessment File